

Valve shown in flanges.
Flanges not included.


The **Flange Insert (F1, F6, FP)** valves are the ultimate check valves in flanged systems. They provide the simplest and most economical way to install check valves in a piping system. The valve body helps position itself while bolts are being installed and tightened. Two gaskets are required instead of the one normally used in a flanged joint. See page 52 or consult the factory for additional installation guidelines.

Flange Insert valves are designed to fit between two mating ANSI flanges. The “Spring Housing”, designated by the “A” dimension, is designed to be inserted into the upstream pipe, thereby helping to center it in the pipe. Therefore, there must be clearance between the spring housing and the pipe or flange. Generally speaking, the FIV Class 150 and 300 valves (F1) are designed for standard schedule pipe or Class 150 or 300 flanges, and the FIV Class 600 (F6) valves are designed for schedule 80 pipe or Class 600 flanges.

Flange Insert valves can be used as check valves, low pressure relief valves, and vacuum breakers by simply using different spring settings.

NOTE: Some valve sizes can be supplied with B16.34 certification. Consult the factory for more information.

Body Material ^②	Nominal Pipe Size	Non-Shock Pressure-Temperature Rating		
		ANSI Class 150	ANSI Class 300	ANSI Class 600
316 Stainless Steel (SS)	1/2 - 4	X	X	X
Carbon Steel (CS) Alloy 20 (A2) Alloy C-276 (HC) Alloy B (HB) Monel® (MO) Titanium (TI)	5 - 20	X		
Brass (BR)	1/2 - 4	X	X	
	5 - 20	X		
PTFE (TF)	1/2 - 1-1/2	55 PSIG @ 100°F ^③		
	2 - 6	20 PSIG @ 100°F ^③		
PVC (PV)	1/2 - 6	200 PSIG @ 100°F ^③		

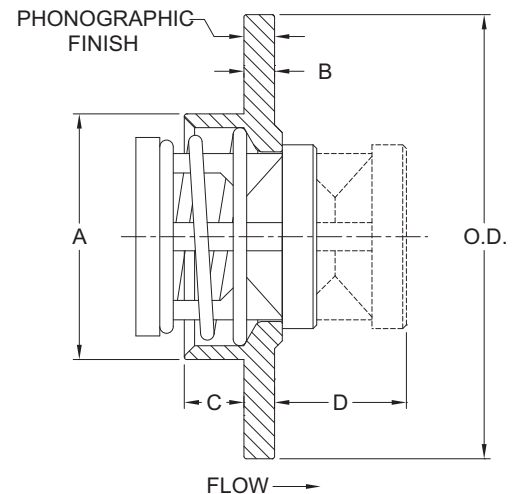

^① Check “A” dimension for clearance with pipe ID. Generally “A” dimension is designed for use in schedule 40 pipe for class 150 & 300 valves (F1). Order class 600 (F6) valves for schedule 80 pipe.

^② See page 54 for material grade information.

^③ Consult the factory for reduced P-T rating above 100°F. Standard spring material is 316 Stainless Steel.

See Diagram on Page 6

FIV (F1, F6, FP) Dimensions

Nominal Pipe Size	Size Code	ANSI Rating & Material	A	B	C	D ^①	O.D.	Orifice ^② Diameter
1/2	D	150 & 300 600 PTFE & PVC	0.605 N/A ^③ 0.600	1/4	0.29 N/A ^③ 0.27	0.55 0.53 0.68	1-3/8	0.348
3/4	F	150 & 300 600 PTFE & PVC	0.762 0.719 0.720	1/4	0.26 0.24 0.26	0.63 0.62 0.77	1-3/4	0.464
1	H	150 & 300 600 PTFE & PVC	1.000 0.922 0.930	1/4	0.36 0.33 0.36	0.81 0.80 0.81	2	0.593
1-1/4	I	150 & 300 600 PTFE & PVC	1.340 1.234 1.240	1/4	0.44 0.39 0.59	0.88 0.87 0.99	2-1/2	0.890
1-1/2	J	150 & 300 600 PTFE & PVC	1.570 1.490 1.490	1/4	0.44 0.40 0.69	1.04 1.03 1.11	2-7/8	1.135
2	K	150 & 300 600 PTFE & PVC	2.005 1.890 1.890	1/4	0.49 0.43 0.52	1.21 1.21 0.93	3-5/8	1.385
2-1/2	L	150 & 300 600	2.407 2.266	1/4	0.66 0.59	1.45 1.45	4-1/8	1.555
3	M	150 & 300 600 PTFE & PVC	3.006 2.844 2.865	5/16	0.70 0.65 0.73	1.63 1.62 1.62	5	2.025
4	N	150 & 300 600 PTFE & PVC	3.964 3.766 3.766	3/8	1.00 0.96 1.00	1.93 1.93 2.04	6-3/16	2.560
5	O	150	4.985	1/2	1.07	2.14	7-5/16	3.280
6	P	150 PTFE & PVC	6.003 5.700	3/8 9/16	1.52 1.55	2.22 2.78	8-1/2	3.875
8	Q	150	7.919	1/2	2.27	3.14	10-5/8	5.110
10	R	150	9.958	1/2	2.84	3.58	12-3/4	6.380
12	S	150 Brass Other Metals	11.876	5/8 1/2	3.12 3.25	4.33 4.18	15	7.670
14	T	150 Brass Other Metals	13.062	11/16 1/2	3.18 3.37	4.58 4.45	16-1/4	8.460
16	U	150 Brass Other Metals	14.938	3/4 9/16	3.69 3.88	5.20 5.05	18-1/2	9.650
18	V	150 Brass Other Metals	16.814	7/8 5/8	3.87 4.12	5.80 5.63	21	10.860
20	W	150 Brass Other Metals	18.750	15/16 11/16	3.88 4.13	6.54 6.26	23	12.110


① Maximum nominal dimension for a fully open valve with no spring.

② Due to molding process, orifice in plastic valves may vary.

③ F6 does not have a spring housing.

Sizes 5" and larger are only available in class 150. Consult the factory if using Schedule 80 pipe.

Flange Insert
Flow Curves assume Schedule 40 pipe
For Water at 72°F

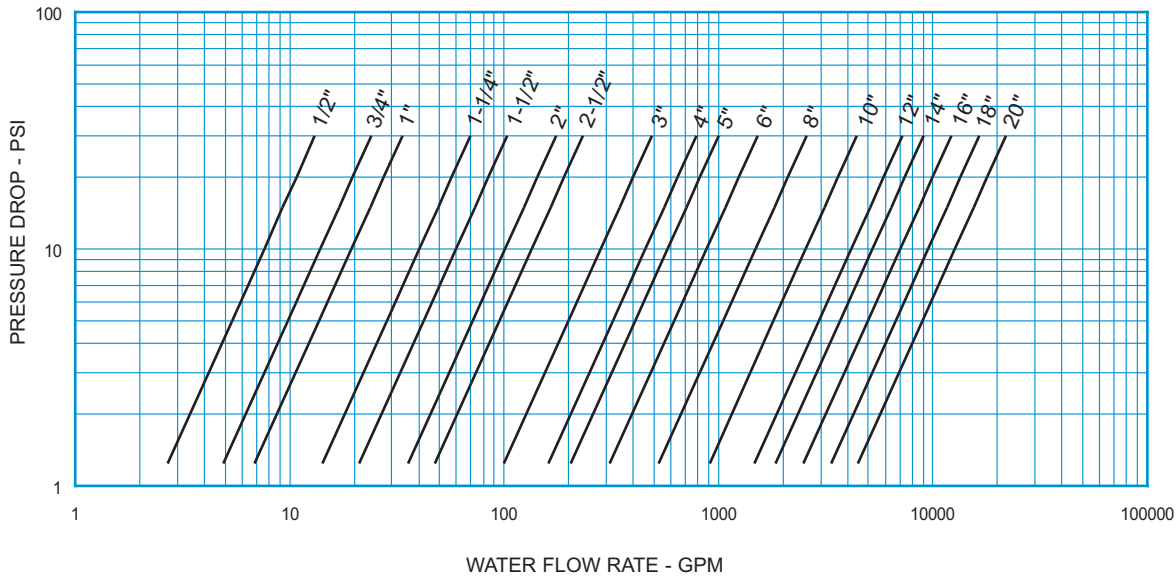


Note: All flow curves and Cv values presume the valves are fully open with 1/2 PSI cracking pressure springs. Consult the factory for more information.

STYLE F1, F6, FP (FIV) C _v VALUES & VALVE WEIGHTS					
C _v	SIZE	SS & CS ALLOYS	BRASS	PTFE	PVC
2.4	1/2	1.7 oz.	1.9 oz.	0.5 oz.	0.3 oz.
4.4	3/4	2.9 oz.	3.2 oz.	0.8 oz.	0.5 oz.
6.1	1	4.2 oz.	4.6 oz.	1.1 oz.	0.7 oz.
12.7	1-1/4	7.0 oz.	7.4 oz.	1.9 oz.	1.4 oz.
18.8	1-1/2	9.5 oz.	9.8 oz.	2.6 oz.	1.7 oz.
32.0	2	16.3 oz.	17.3 oz.	3.8 oz.	2.6 oz.
42.5	2-1/2	1.4 lb.	1.5 lb.	---	---
89.0	3	2.3 lb.	2.6 lb.	9.6 oz.	6.1 oz.
144	4	4.5 lb.	4.9 lb.	1.2 lb.	12.7 oz.
182	5	8.2 lb.	8.7 lb.	---	---
284	6	12.3 lb.	13.0 lb.	1.8 lb.	1.2 lb.
535	8	24.4 lb.	26.4 lb.	---	---
810	10	40 lb.	44 lb.	---	---
1200	12	51 lb.	58 lb.	---	---
1650	14	74 lb.	93 lb.	---	---
2230	16	105 lb.	130 lb.	---	---
3010	18	157 lb.	201 lb.	---	---
4000	20	207 lb.	262 lb.	---	---

C_v values assume Schedule 40 pipe. Valve weights are approximate.
See page 50 for Flow Formulae.

HOW TO ORDER CHECK-ALL STYLE F1, F6, FP (FIV)

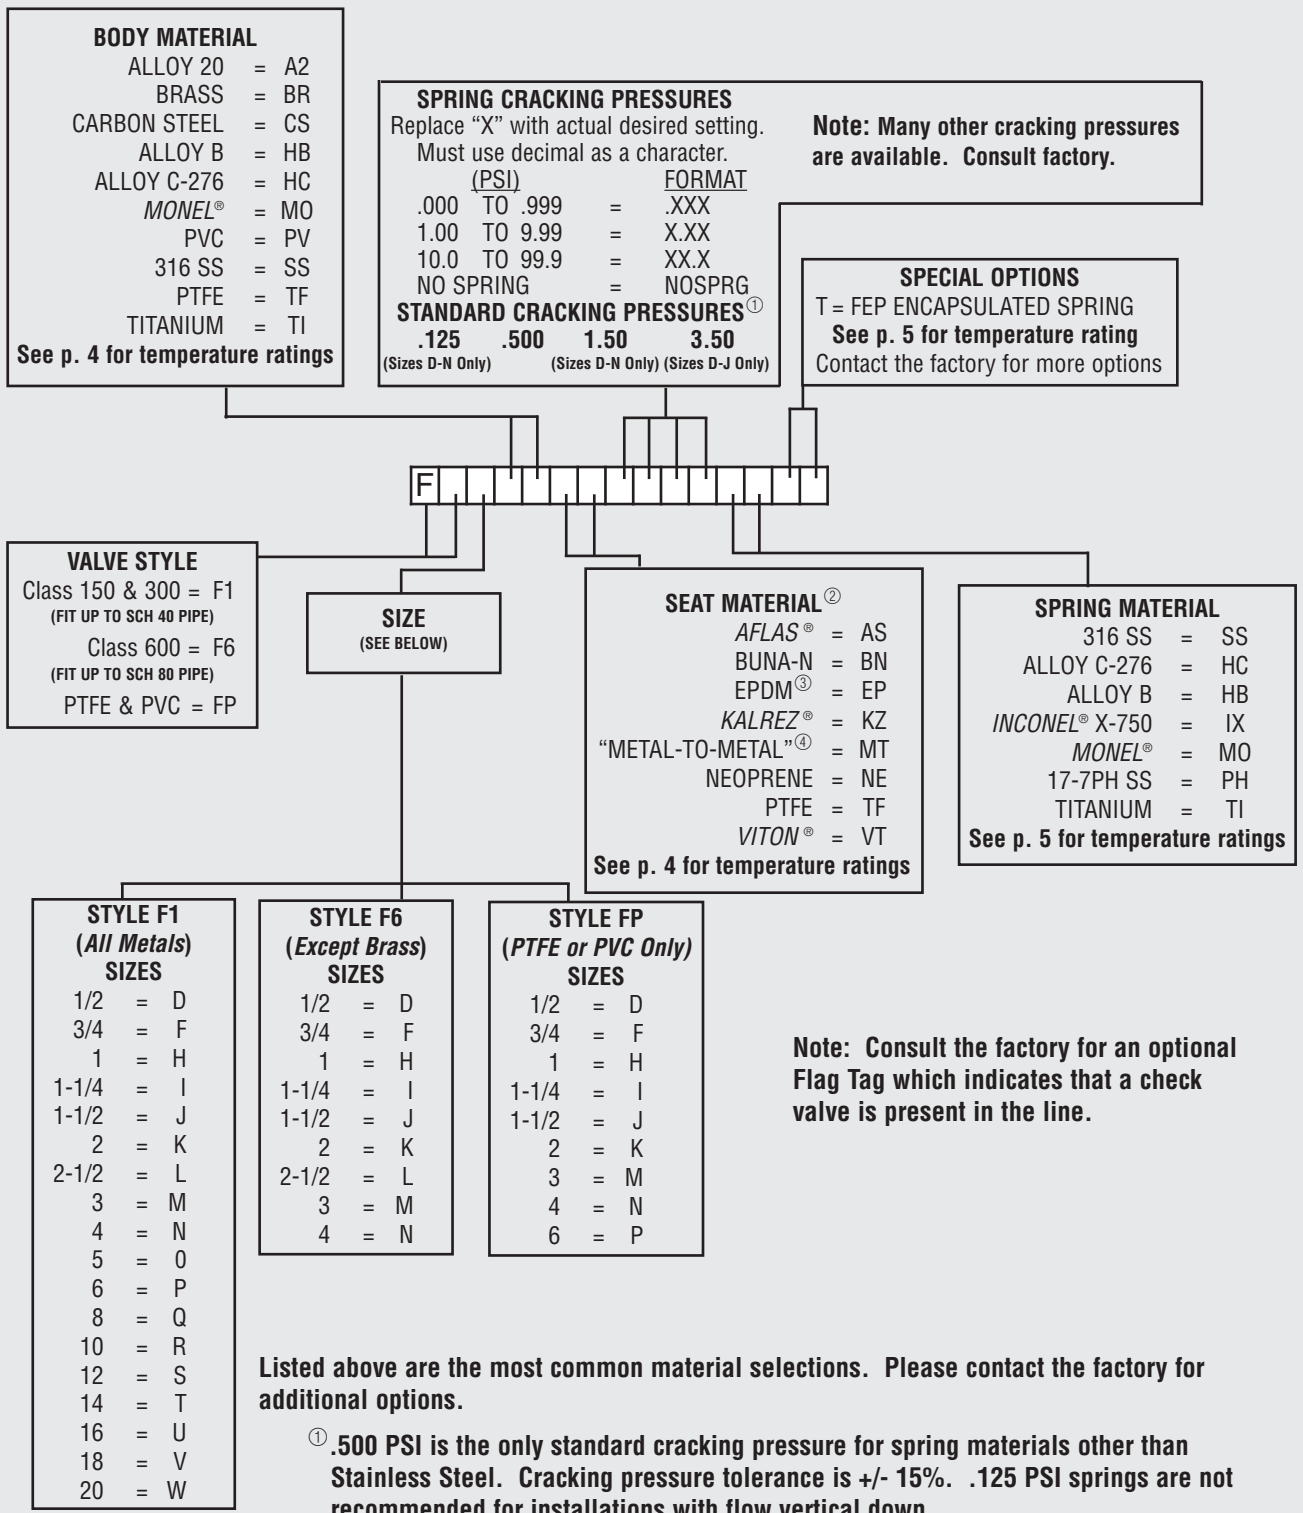

Note: Consult the factory for an optional Flag Tag which indicates that a check valve is present in the line.

Listed above are the most common material selections. Please contact the factory for additional options.

- ① .500 PSI is the only standard cracking pressure for spring materials other than Stainless Steel. Cracking pressure tolerance is +/- 15%. .125 PSI springs are not recommended for installations with flow vertical down.
- ② Seat materials other than "metal-to metal" have a maximum pressure rating of 1500 PSI. "Metal-to-Metal" and PTFE seats are not resilient. See page 51 for allowable leakage rates.
- ③ EP Seats not recommended for use with Carbon Steel valves.
- ④ For plastic valves, "MT" seats mean plastic to plastic. Consult factory for further information.