
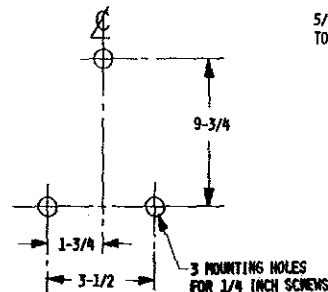
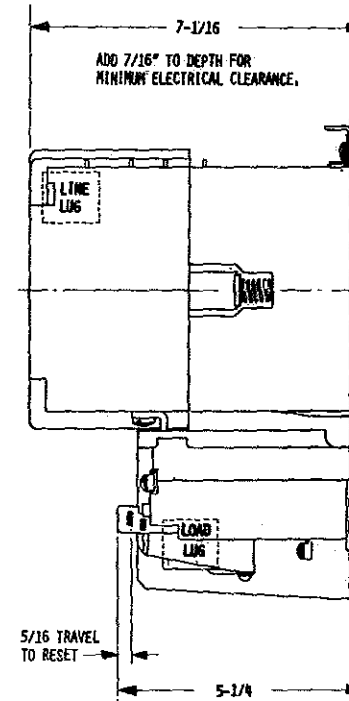


A 60-301166

REVISIONS
4-15-73
SYLV. WAS
ADD. TEG
ECN 80578
11-18-85
ADD. 1
JOSLYN
LOAD
LUGS -
6013-54
1985 54

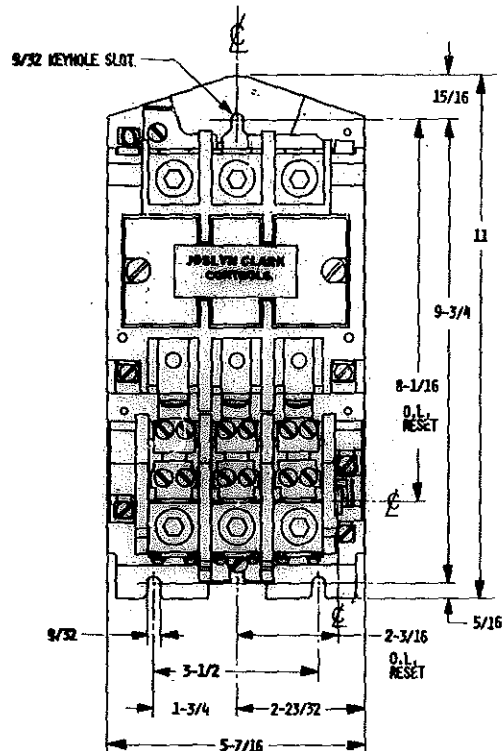

- NOTES:
1. THE 4TH POWER POLE MAY BE MOUNTED ON EITHER SIDE, BUT ONLY 1 PER DEVICE. EXTENSION IS 1-1/2".
 2. AUXILIARY SIDE MOUNTED CONTACTS MOUNT ON EITHER OR BOTH SIDES OF A 3-POLE DEVICE OR ON ONE SIDE ONLY OF A 4-POLE DEVICE. EXTENSION IS 3/4".
 3. IF STANDARD LUGS ARE NOT USED, ATTACH POWER WIRING WITH 5/16-18 x 3/8" SCREWS.

DIMENSION OUTLINE (INCHES)
TM SIZE 3 AND 4, 3-POLE STARTER

JOSLYN CLARK CONTROLS INC.

A 60-301166

LANCASTER, S.C. 29720

SHEET OF SHEETS

TITLE: BUL 6013 TYPE TM SIZE 3-4 STARTER
MADE BY: A.P.D. APP'D BY: J.R.H. DATE: 11-9-73 SCALE: NONE

DIMENSION TOLERANCES - EXCEPT AS SPECIFIED
± .005 ON 3 PLACE DECIMALS
± .010 ON 2 PLACE DECIMALS

ANGULAR ± 15°
FRACTIONAL ± 1/64